
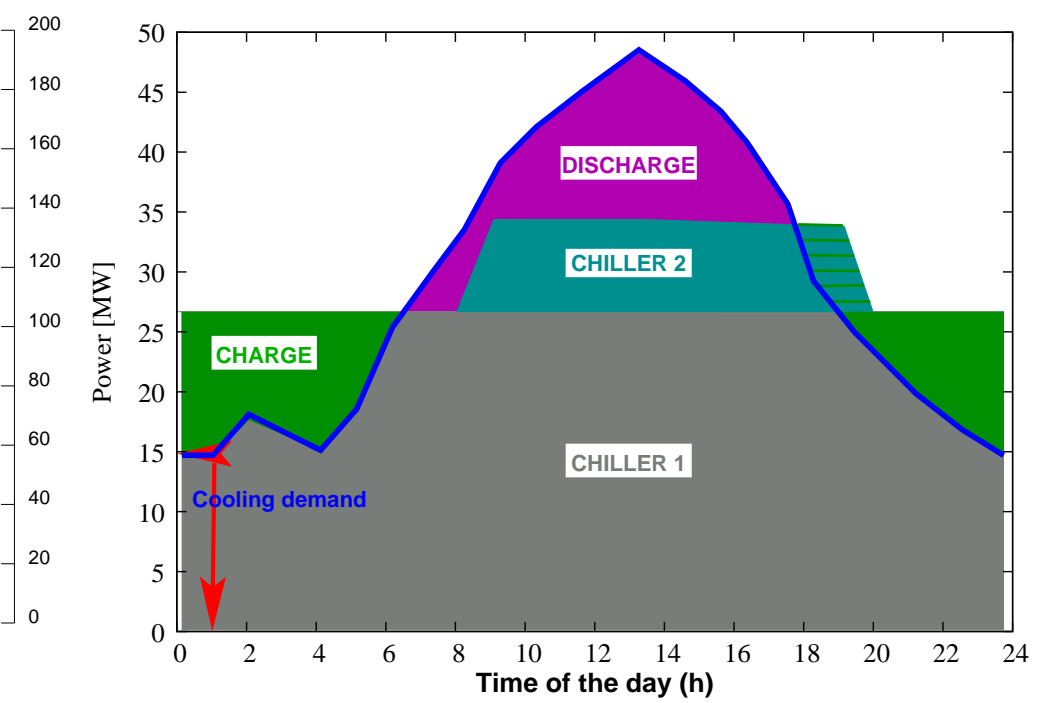




HYDRORAM AB

Simulation of a district cooling system

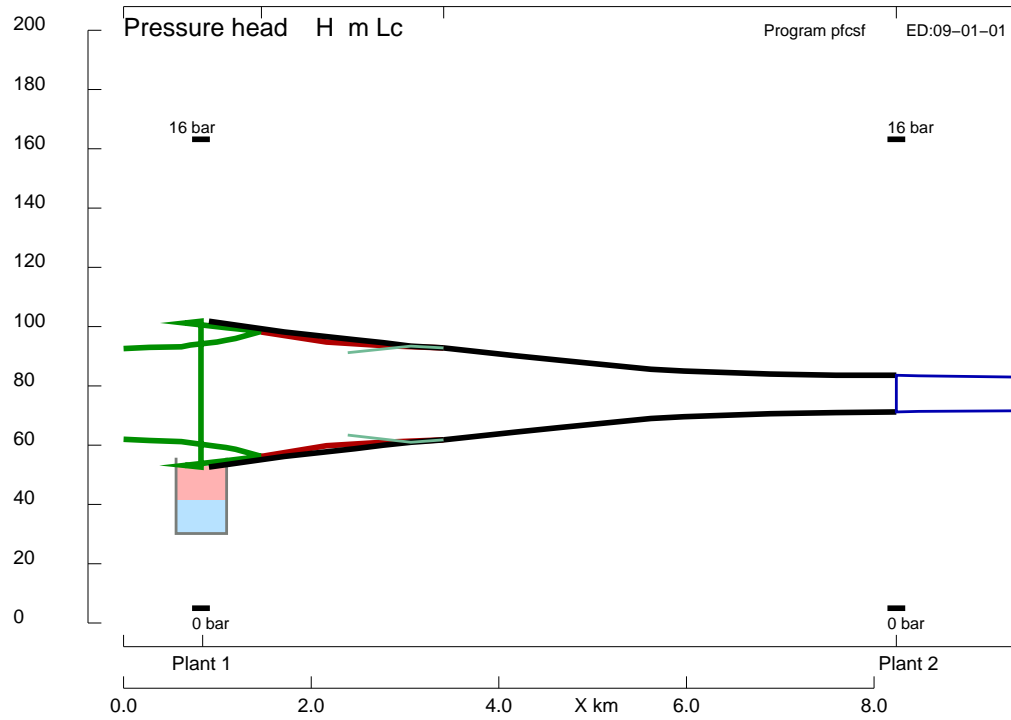



HYDRORAM AB

Simulation of a district cooling system

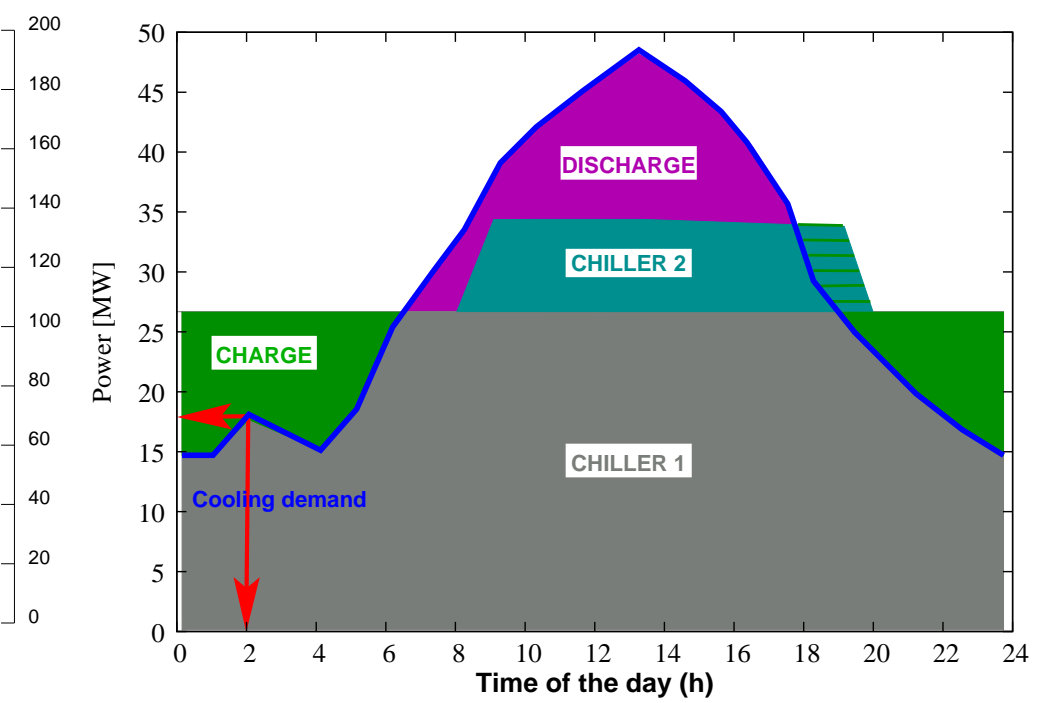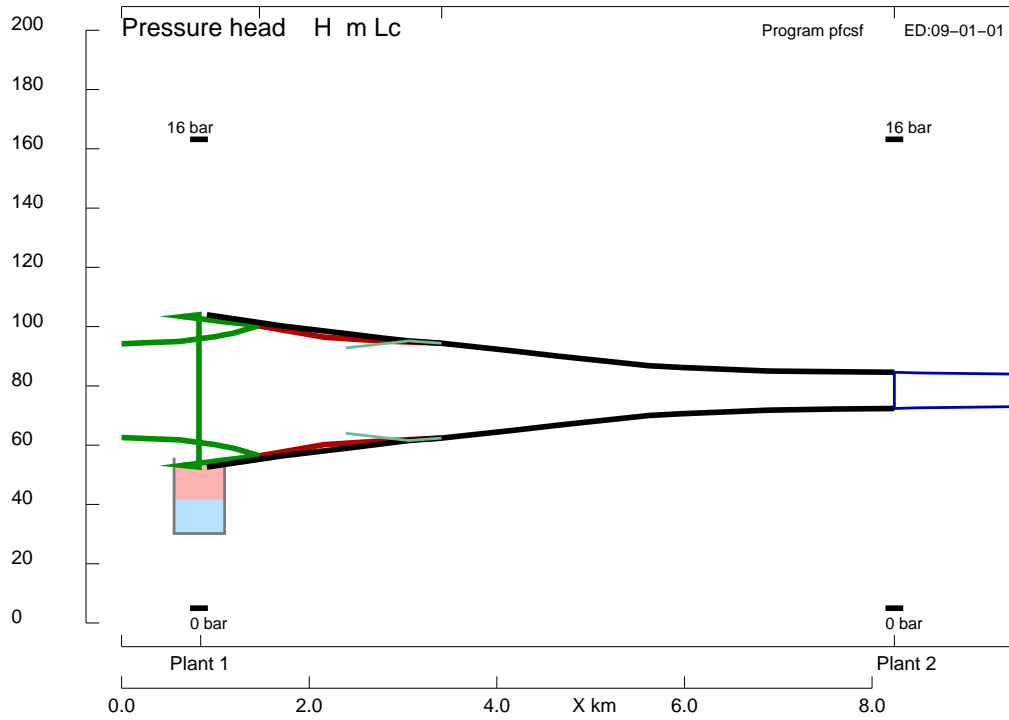



HYDRORAM AB

Simulation of a district cooling system

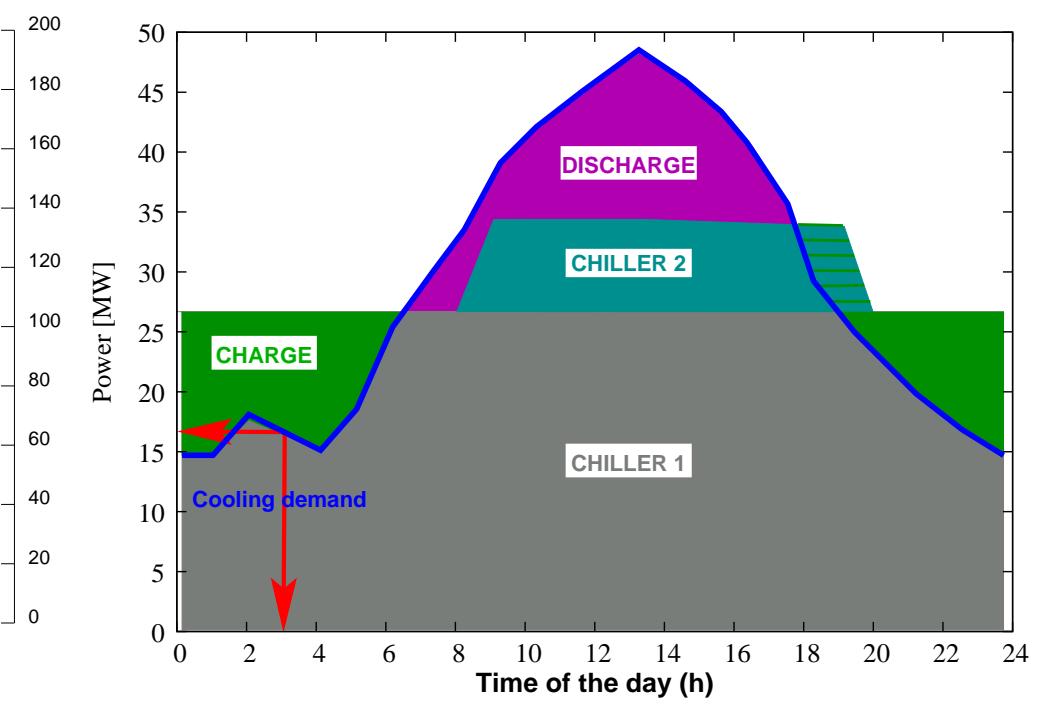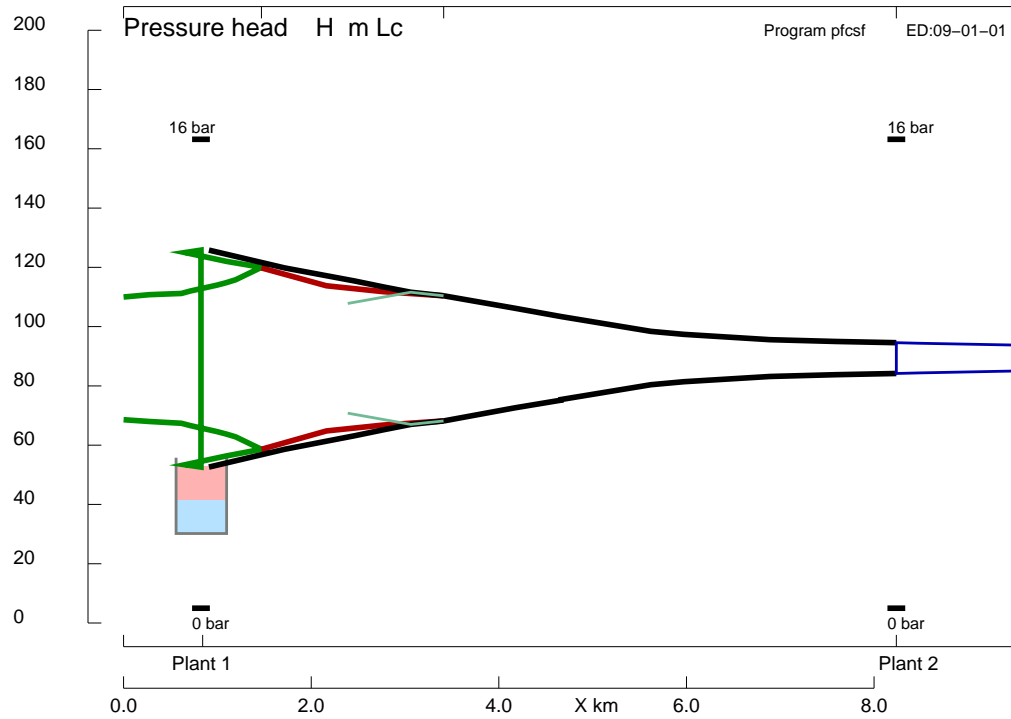



HYDRORAM AB

Simulation of a district cooling system

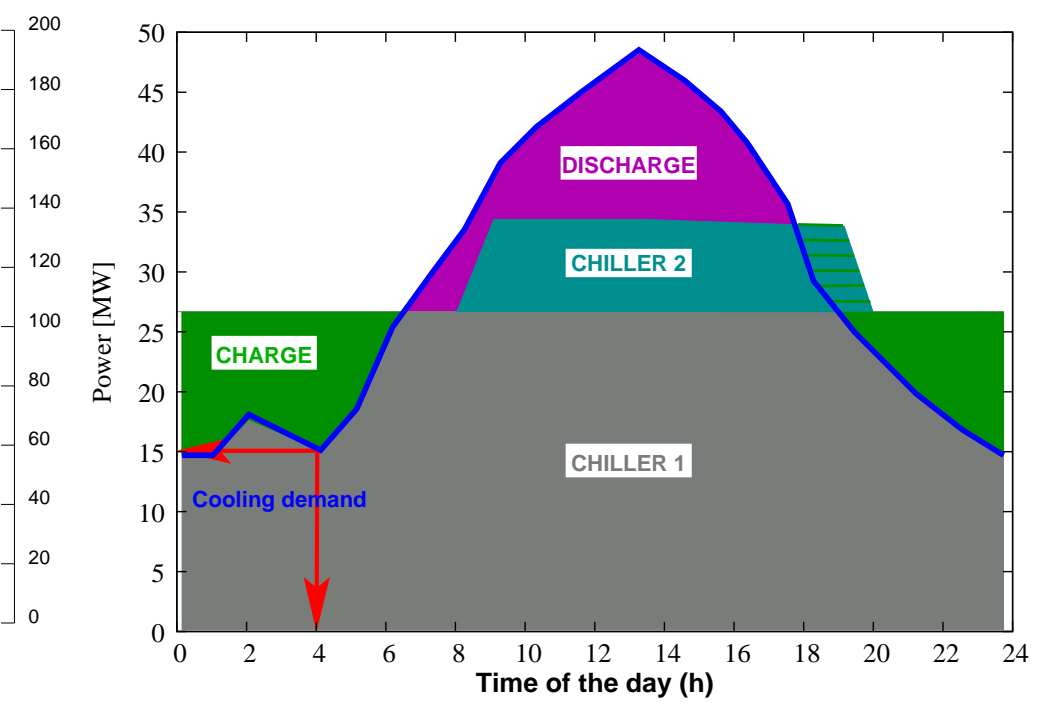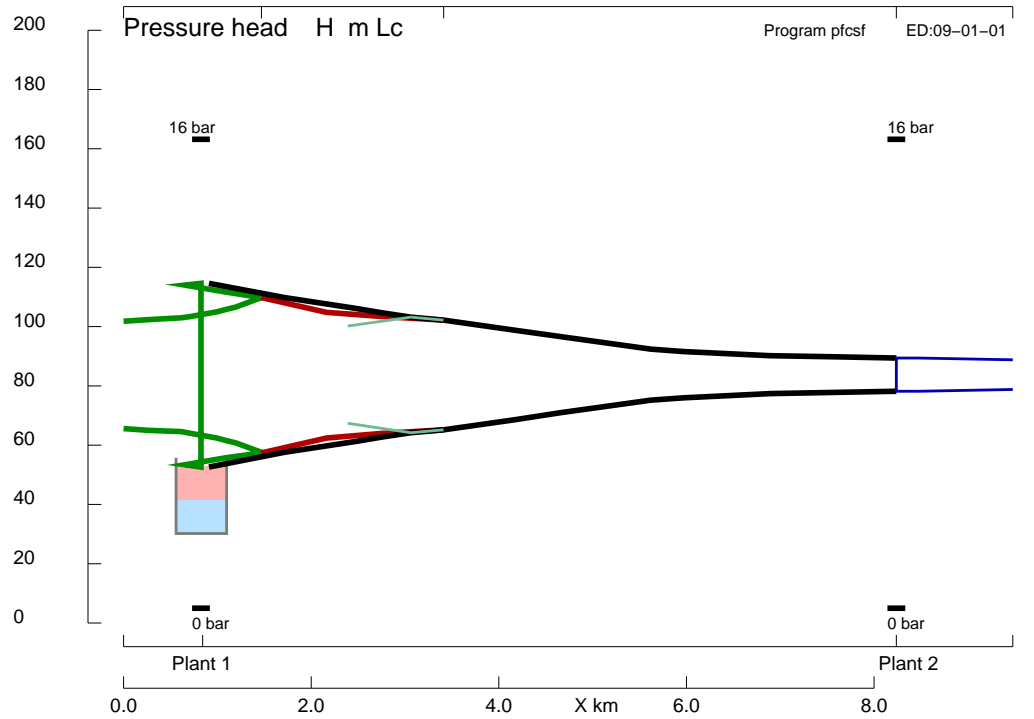



HYDRORAM AB

Simulation of a district cooling system

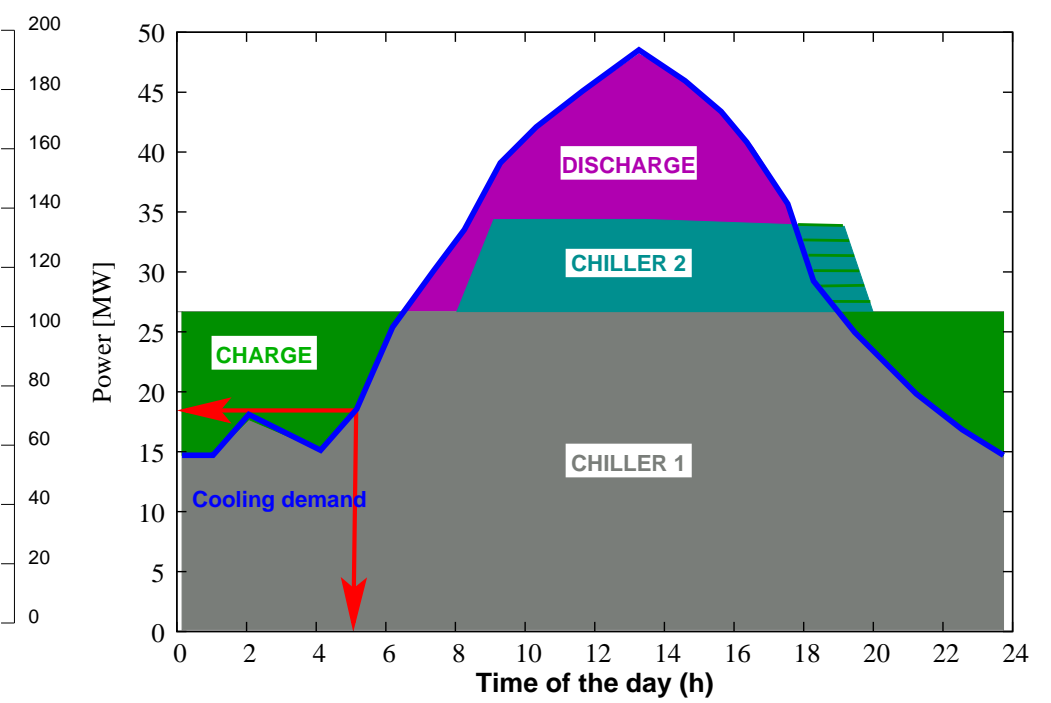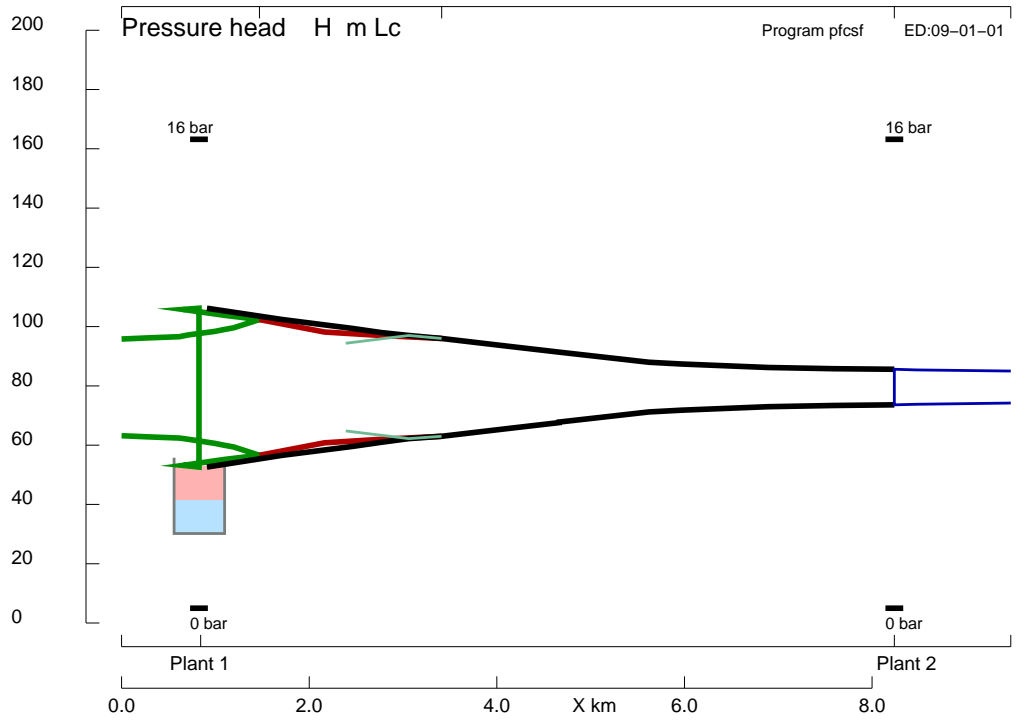



HYDRORAM AB

Simulation of a district cooling system

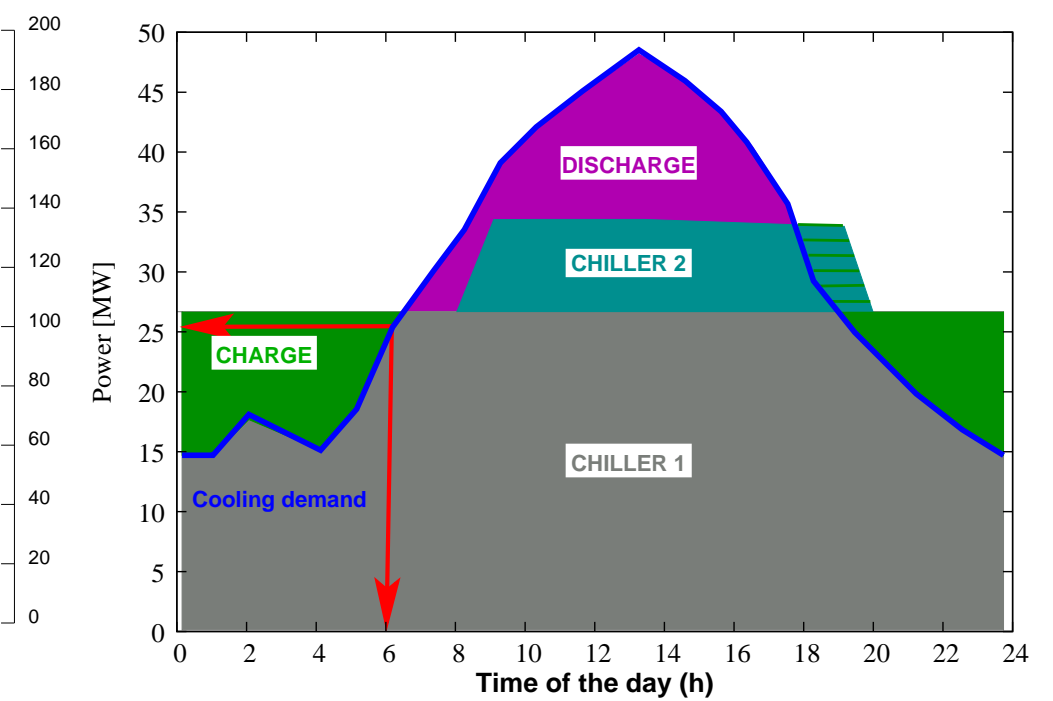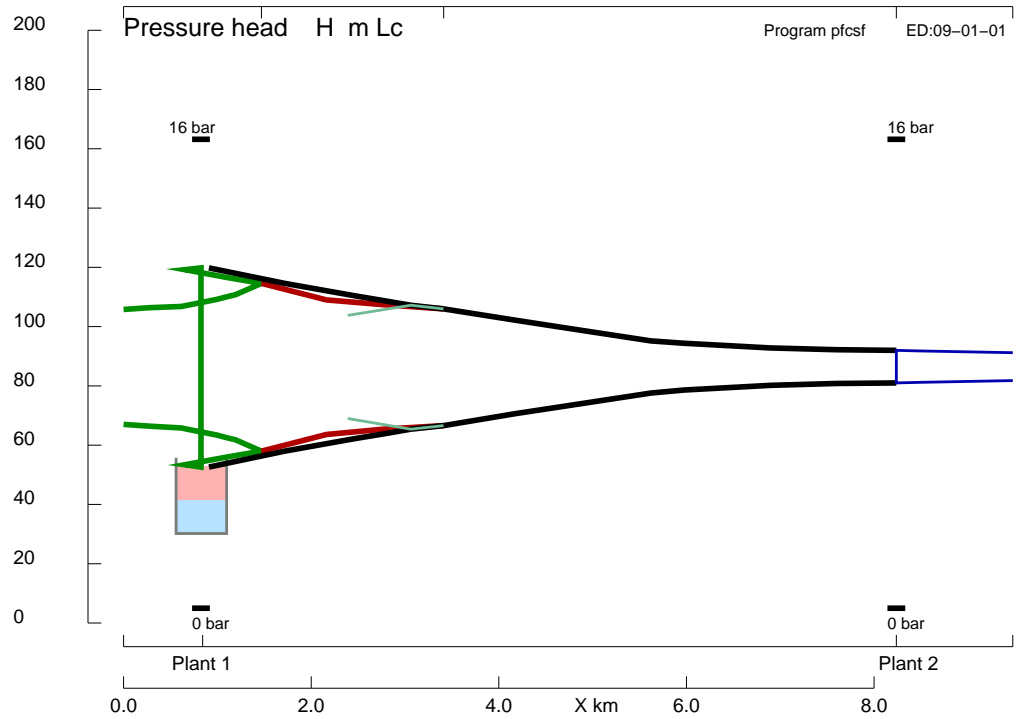



HYDRORAM AB

Simulation of a district cooling system

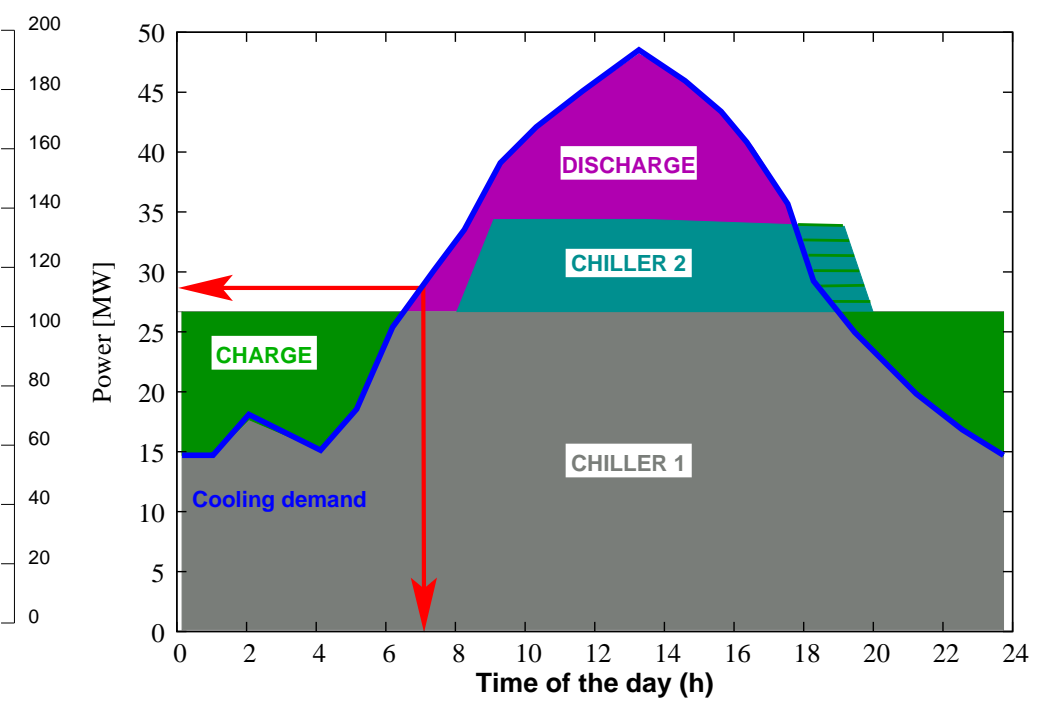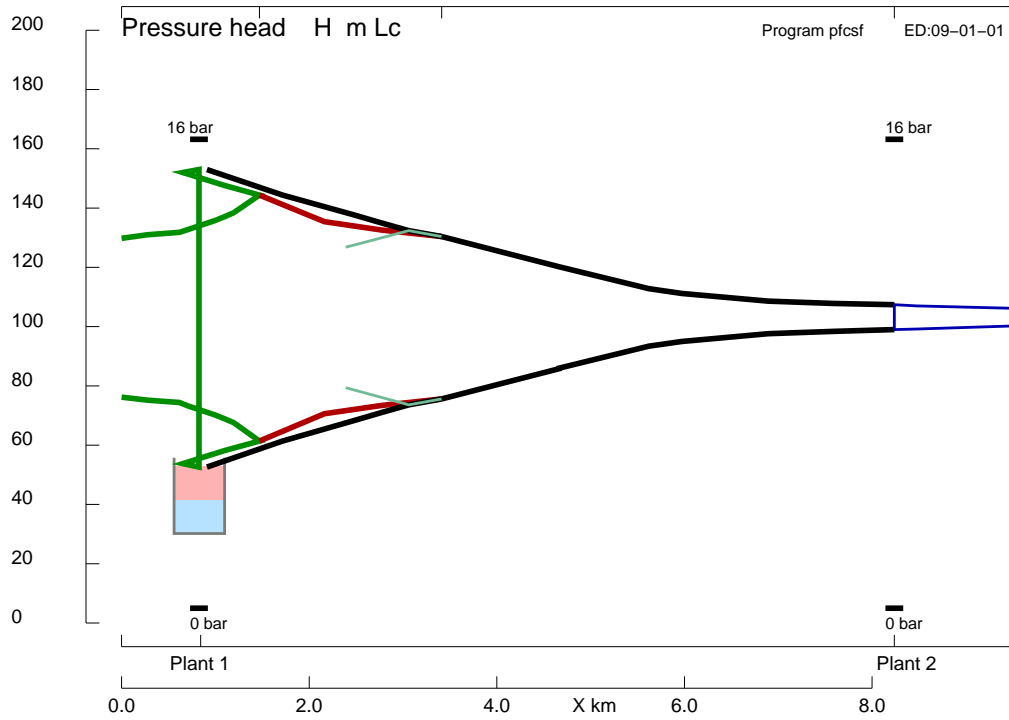



HYDRORAM AB

Simulation of a district cooling system

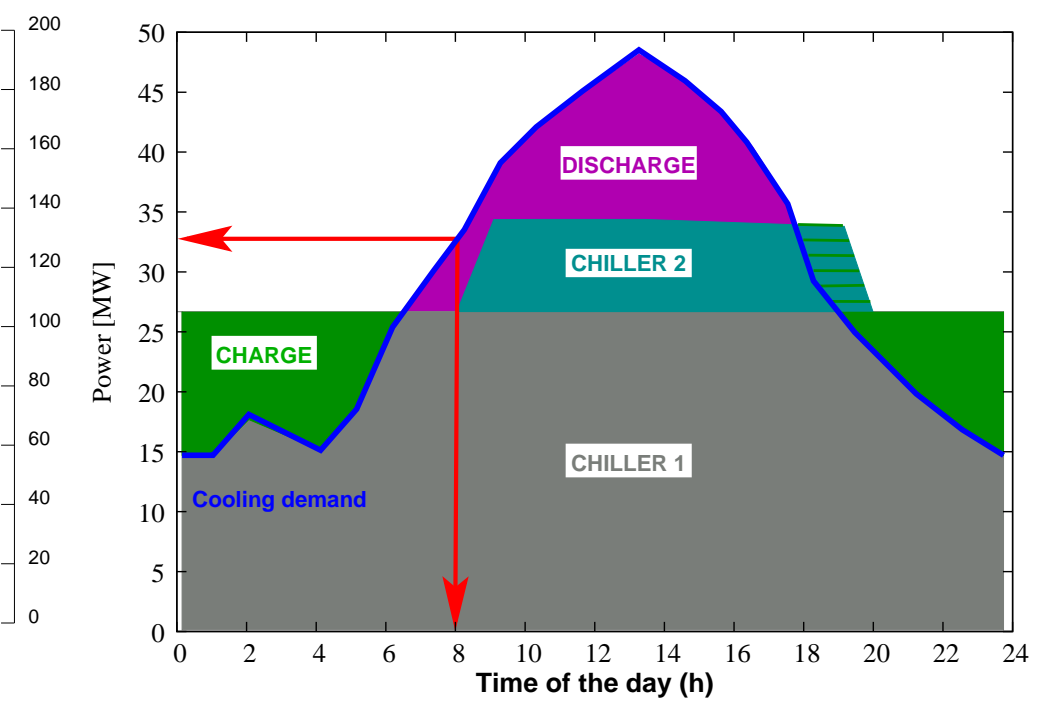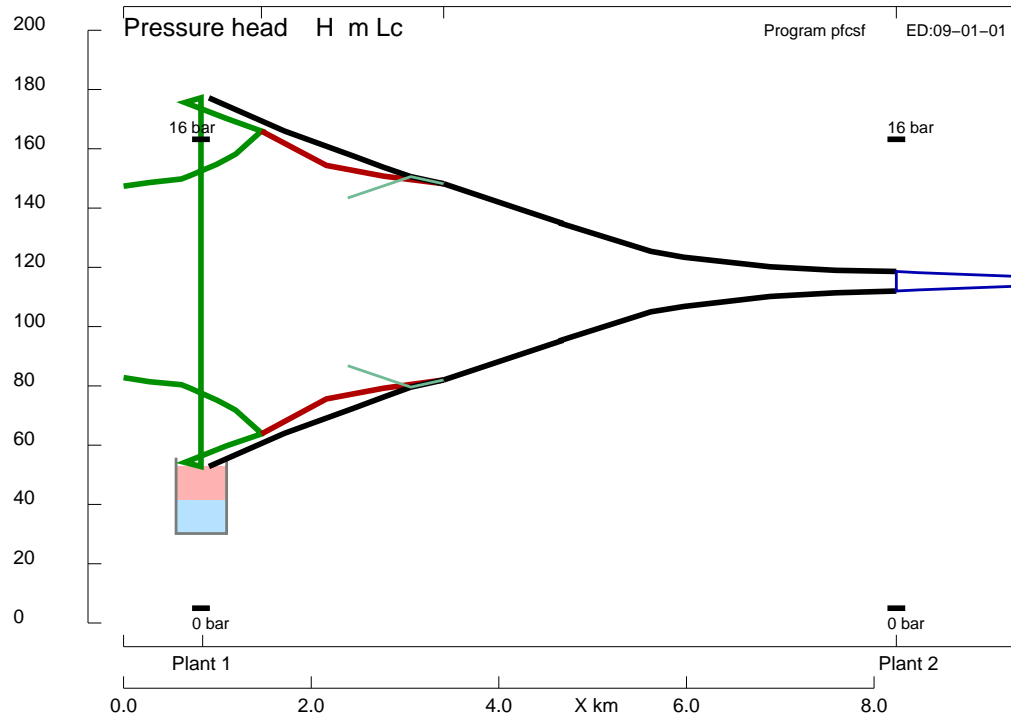



HYDRORAM AB

Simulation of a district cooling system

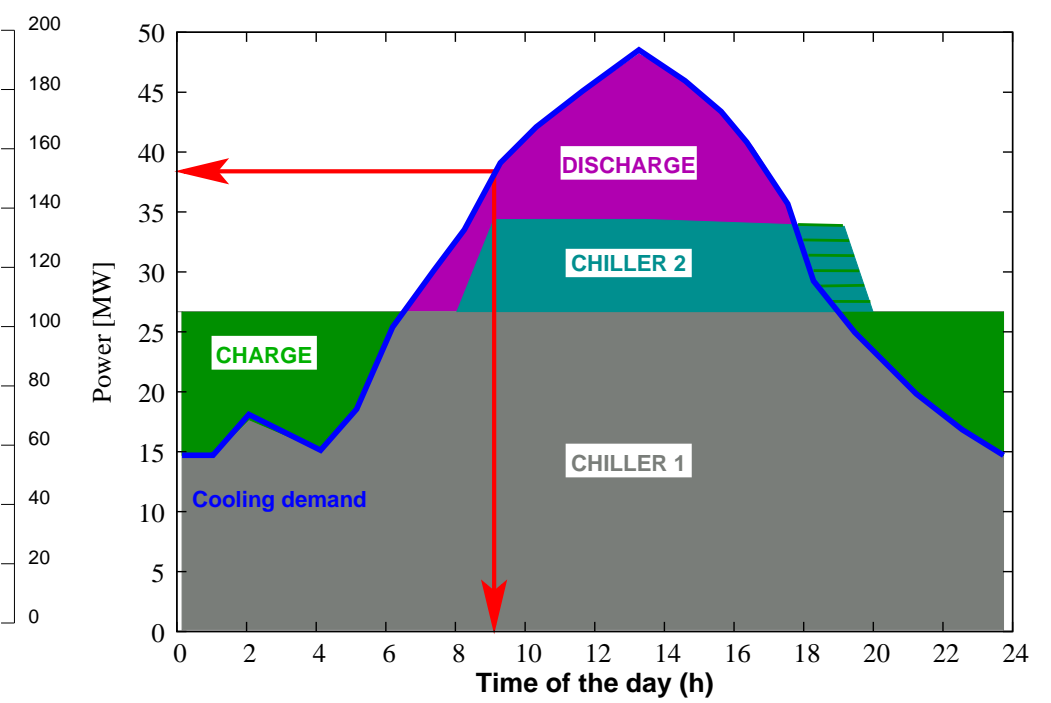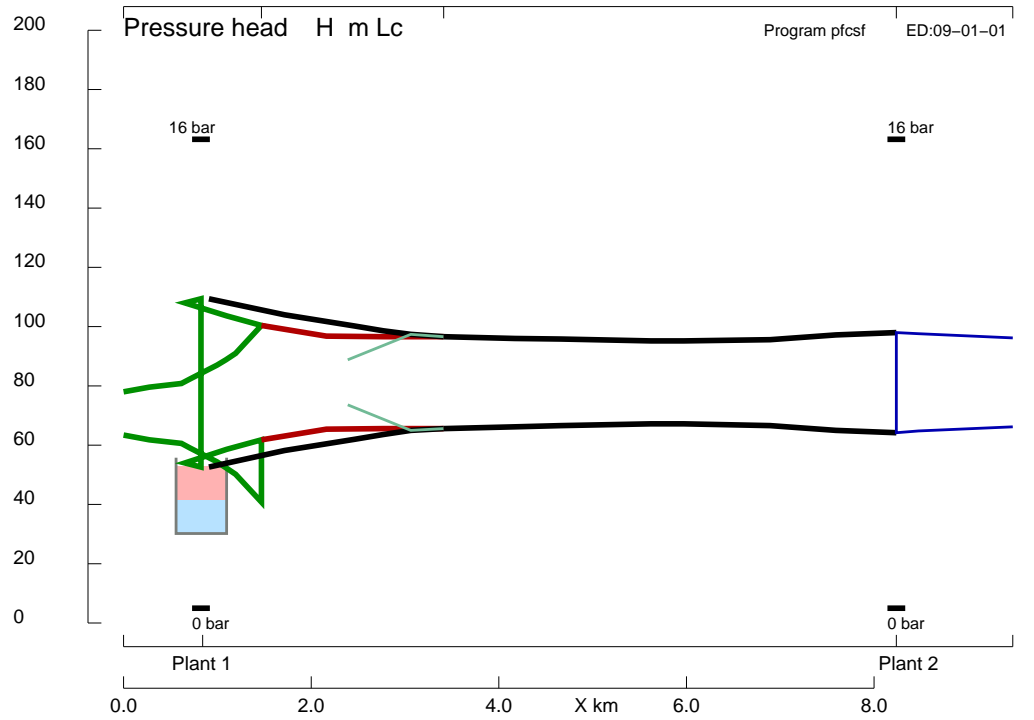



HYDRORAM AB

Simulation of a district cooling system

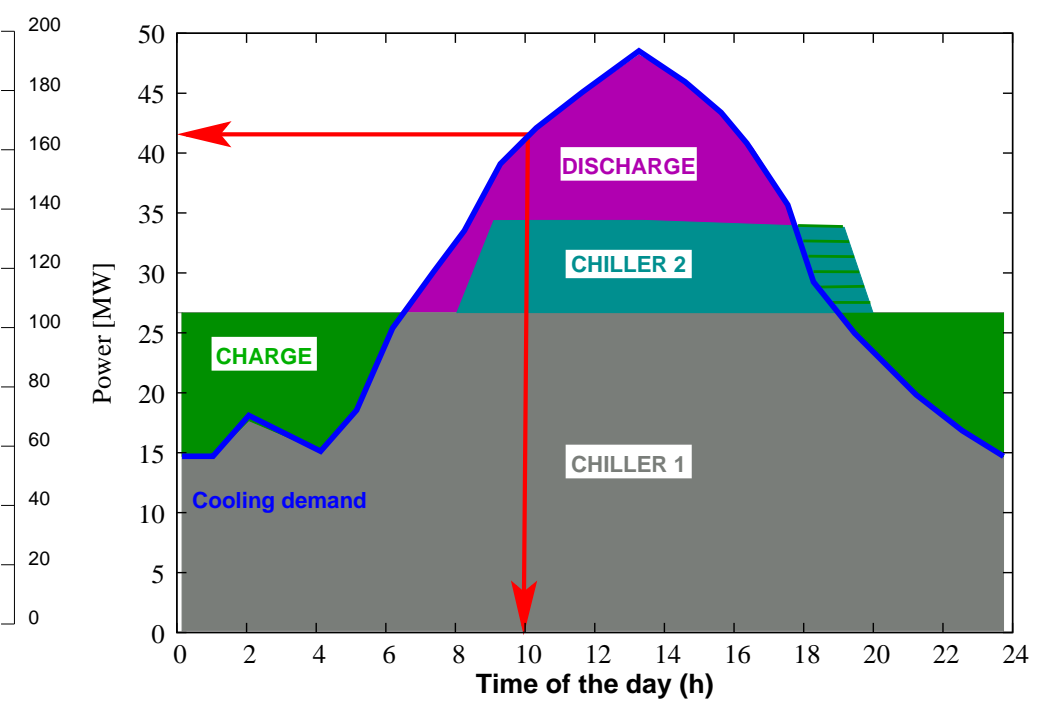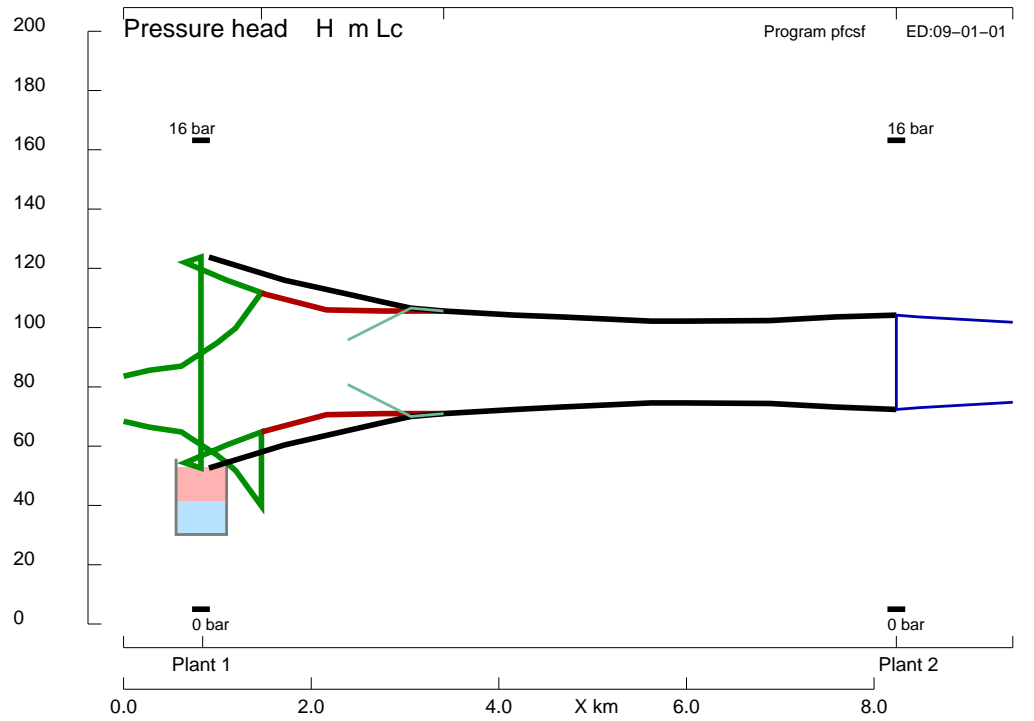



HYDRORAM AB

Simulation of a district cooling system

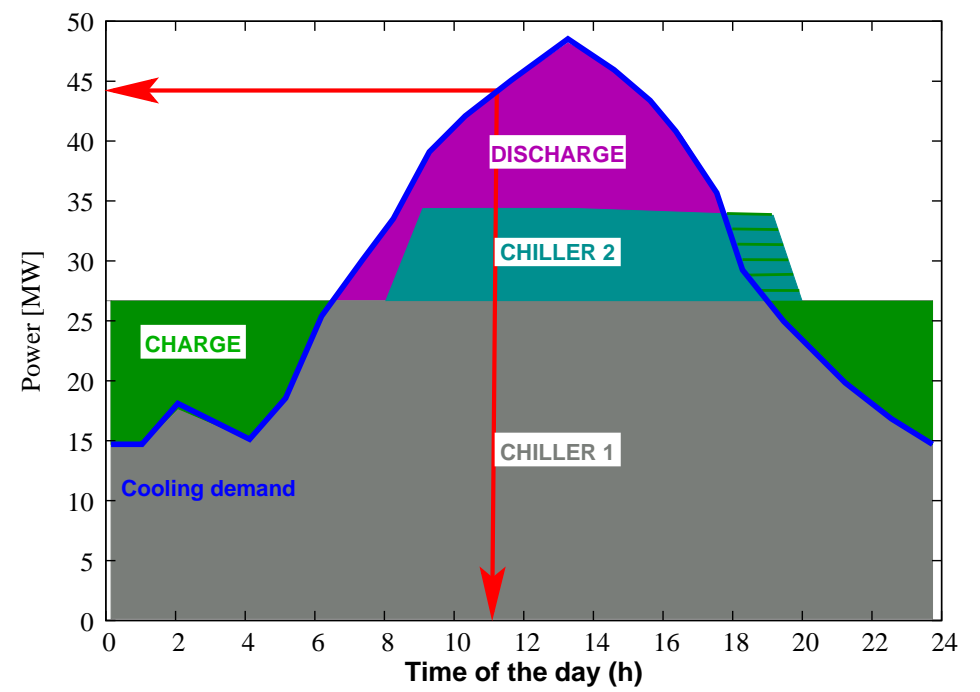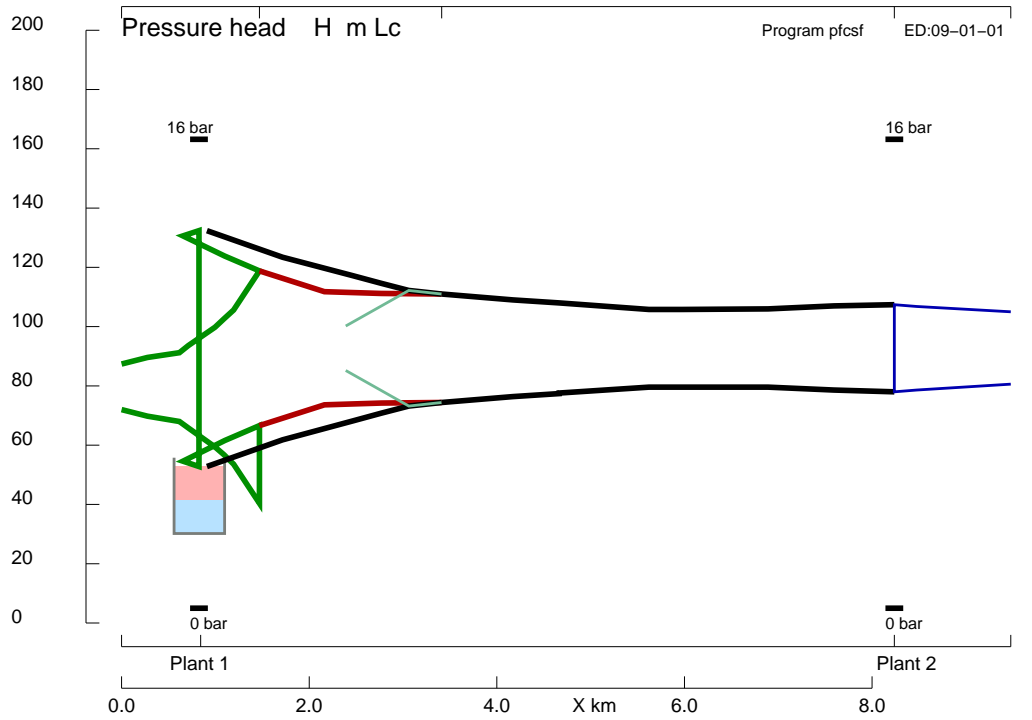



HYDRORAM AB

Simulation of a district cooling system

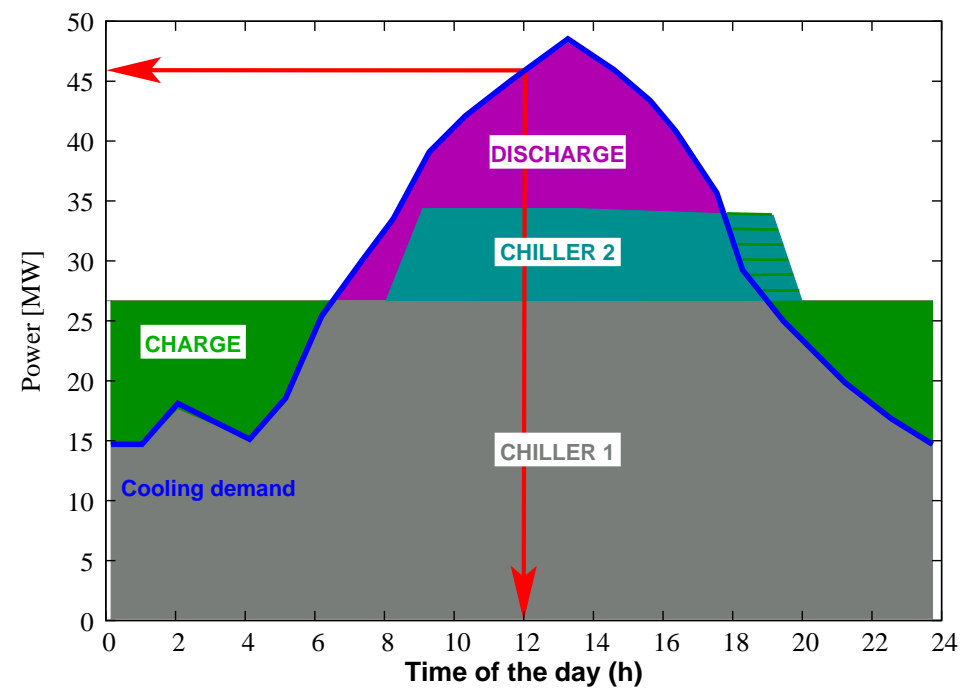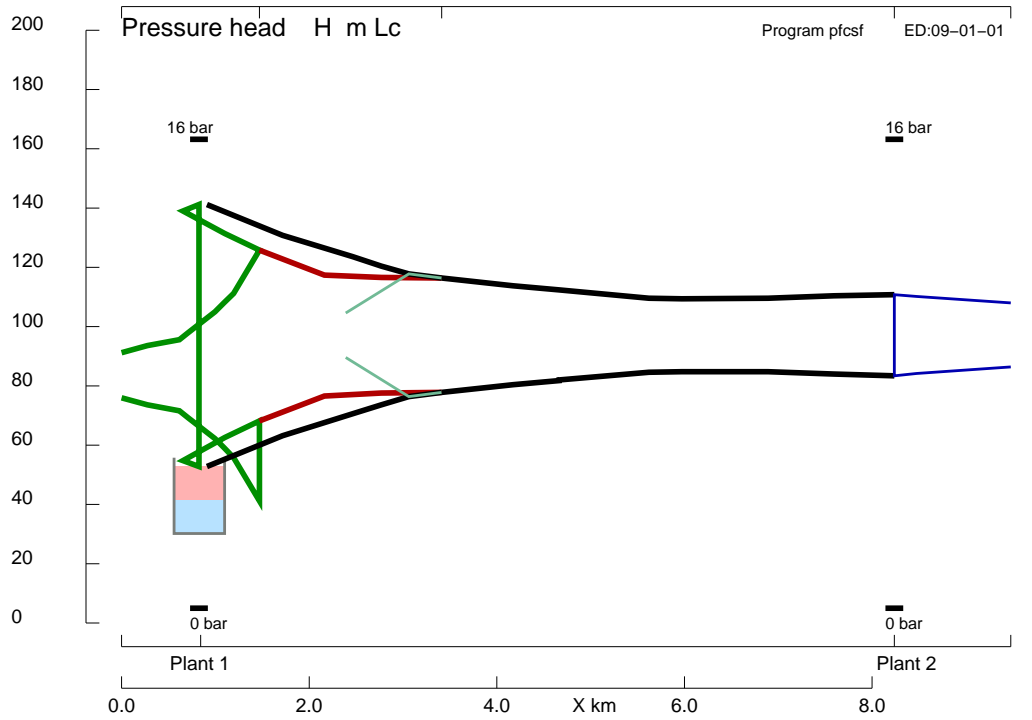



HYDRORAM AB

Simulation of a district cooling system

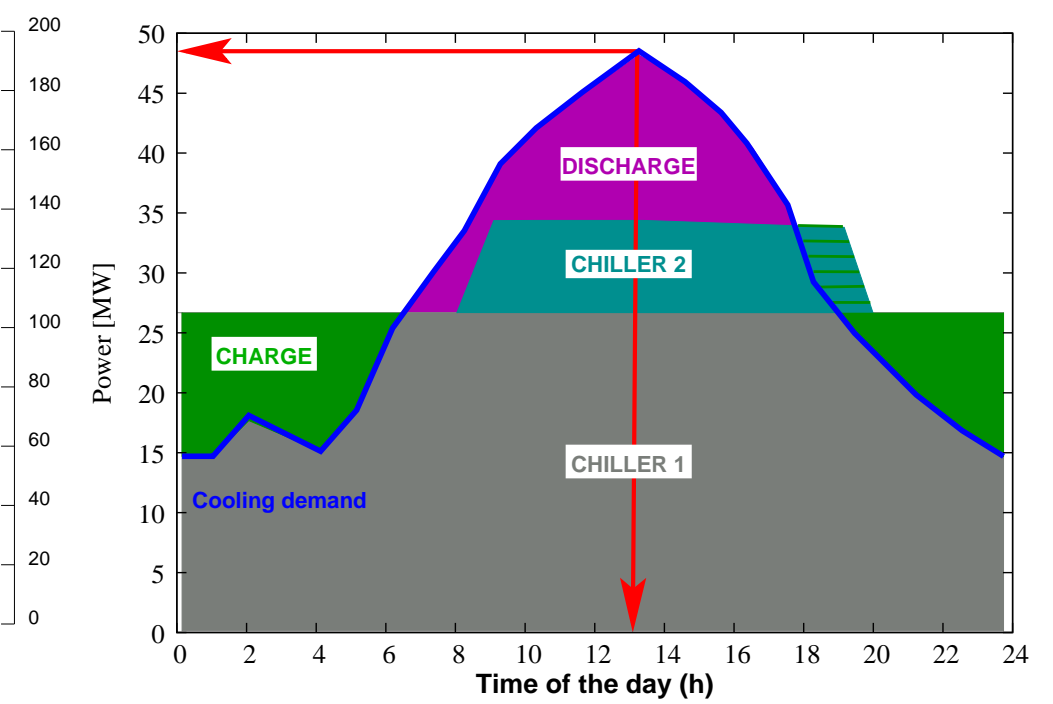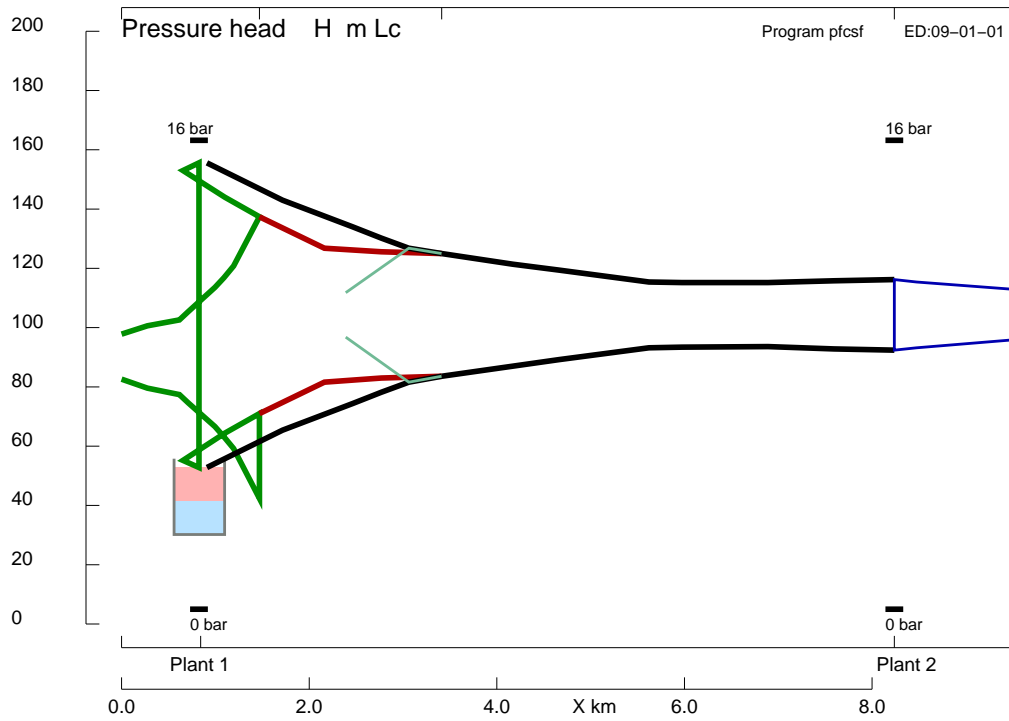



HYDRORAM AB

Simulation of a district cooling system

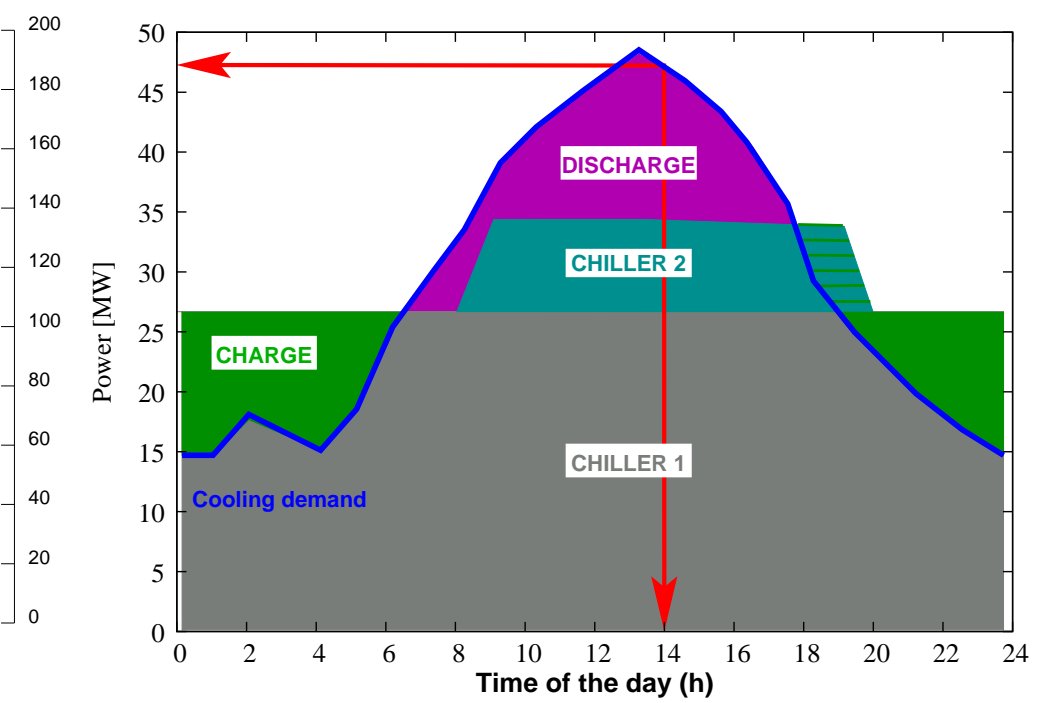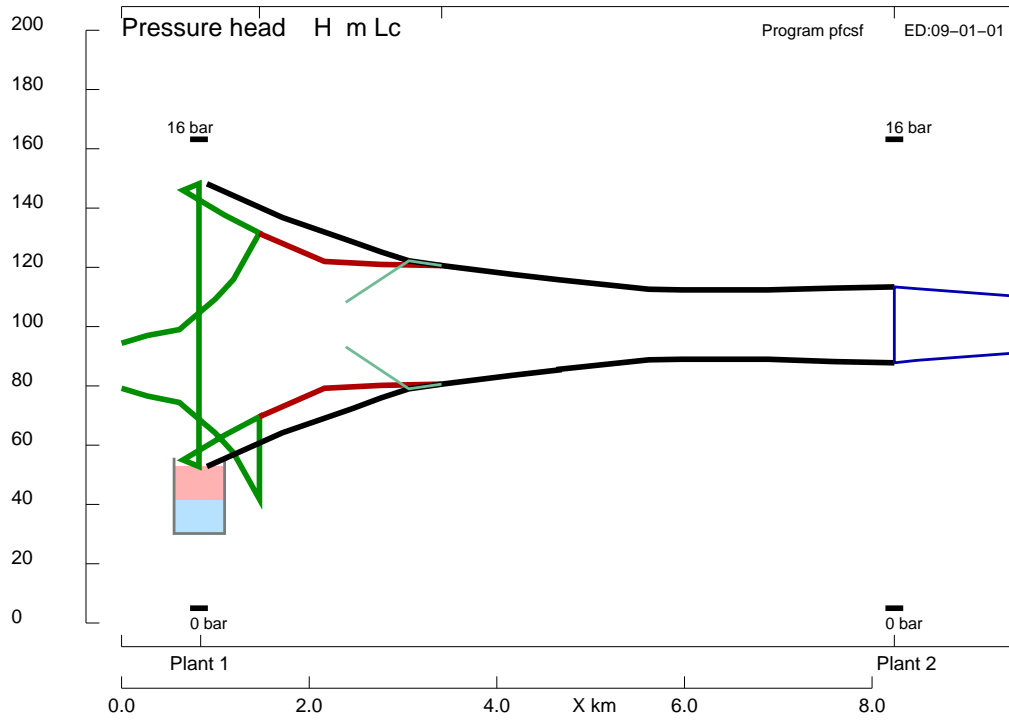



HYDRORAM AB

Simulation of a district cooling system

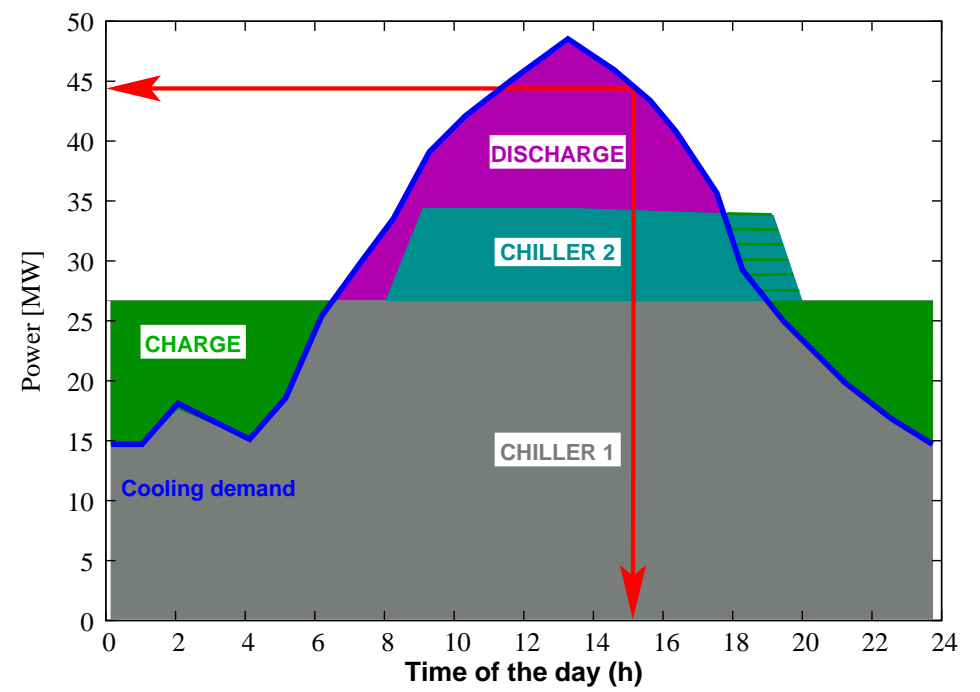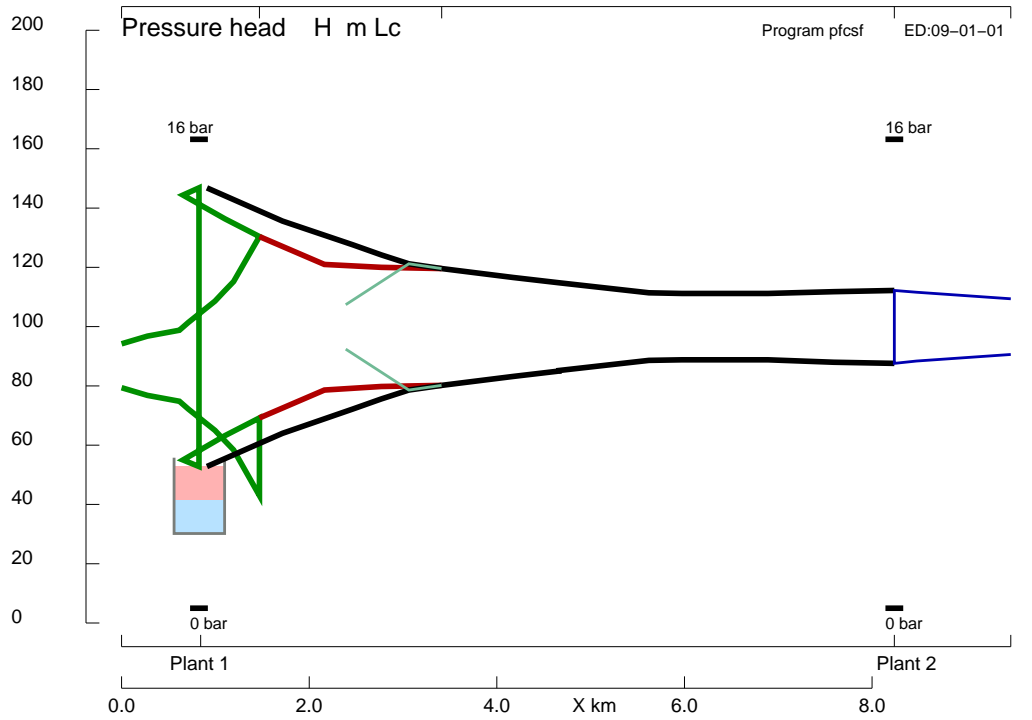



HYDRORAM AB

Simulation of a district cooling system

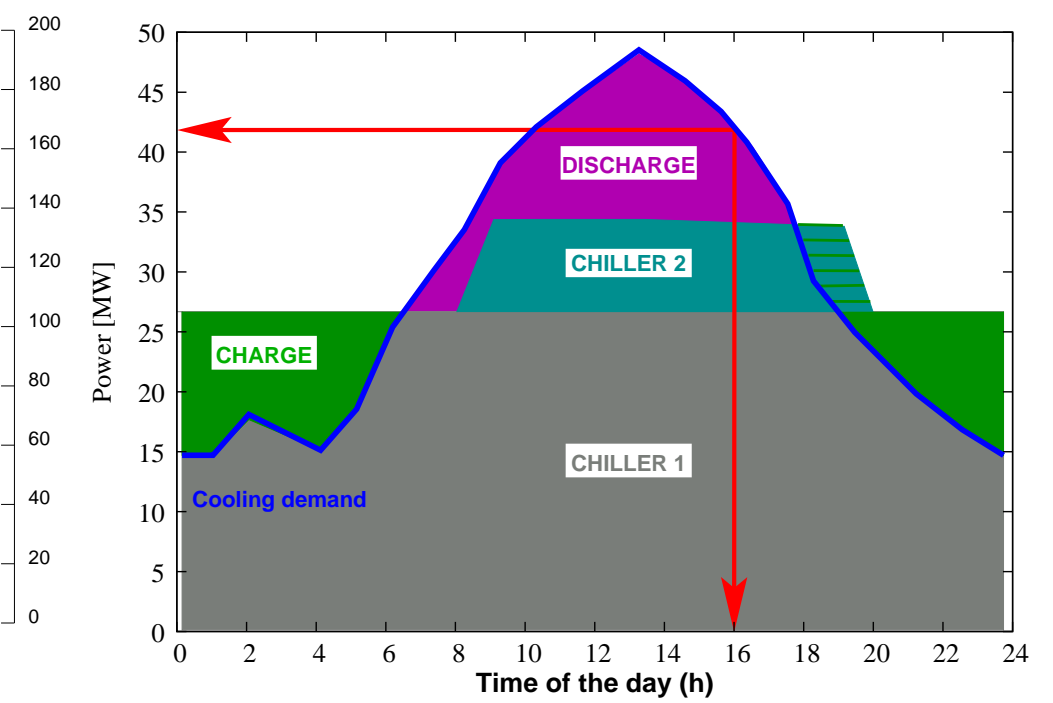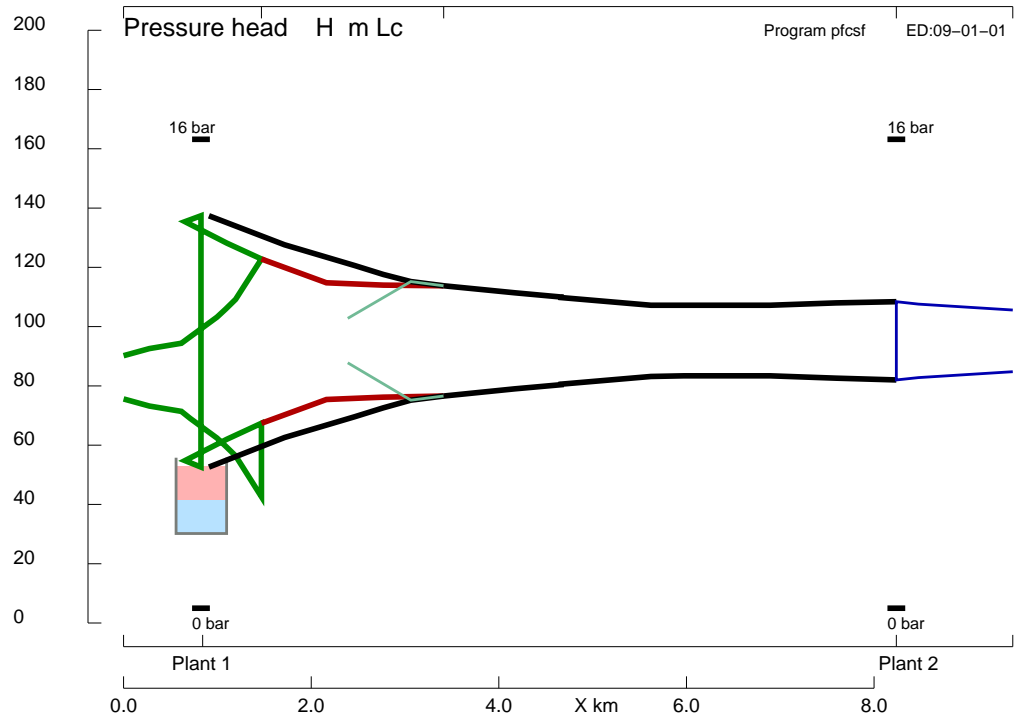



HYDRORAM AB

Simulation of a district cooling system

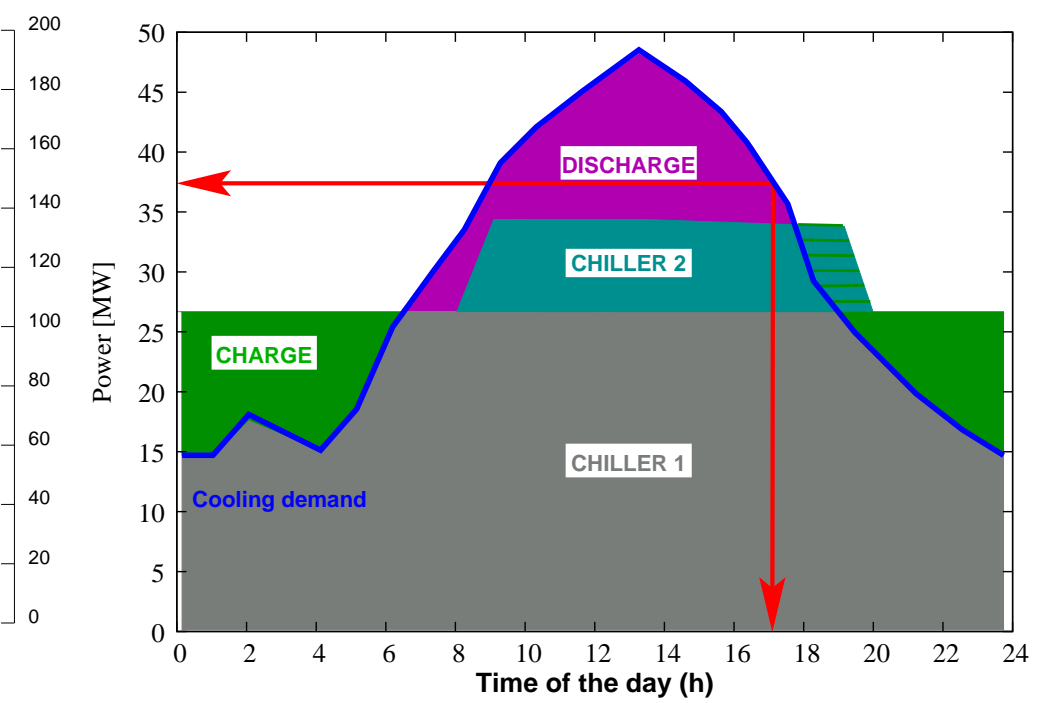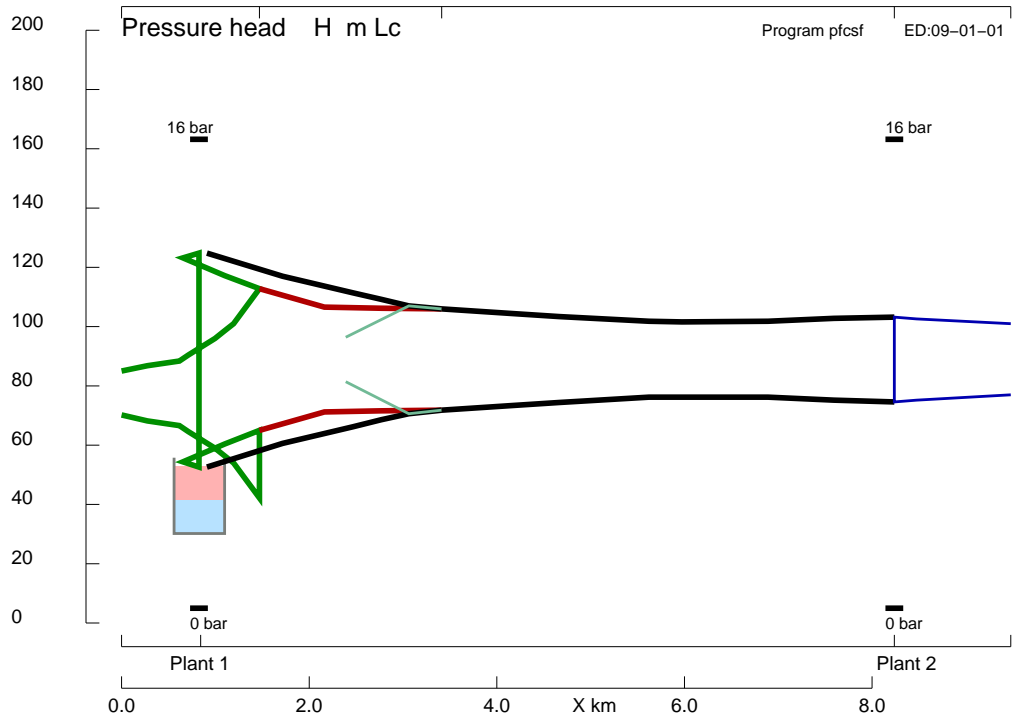



HYDRORAM AB

Simulation of a district cooling system

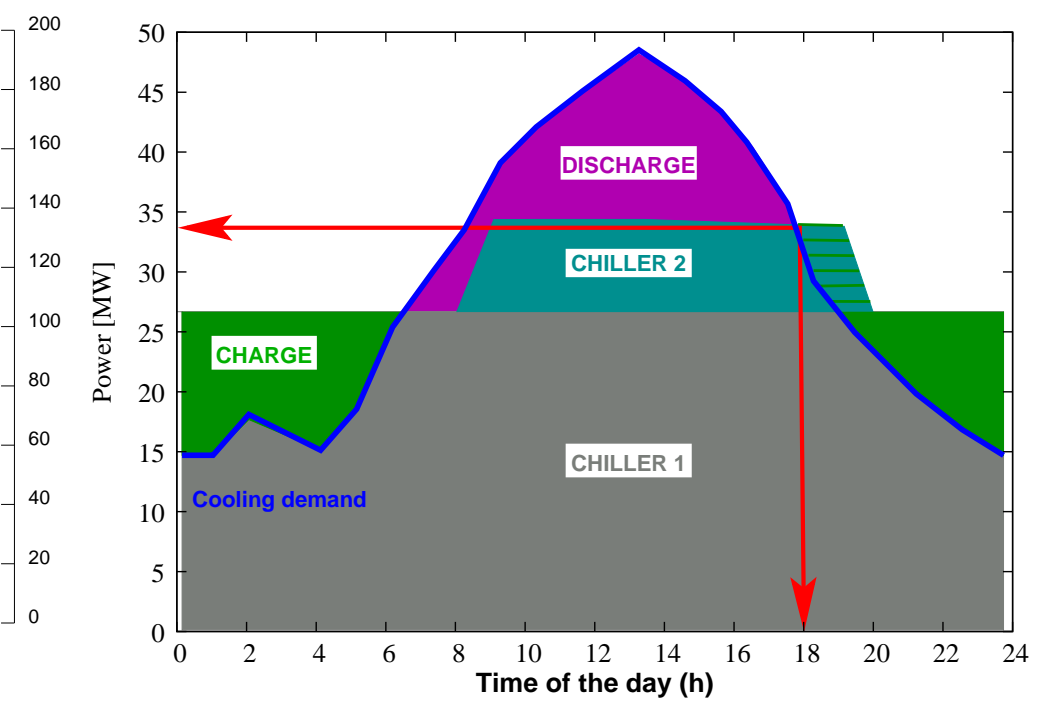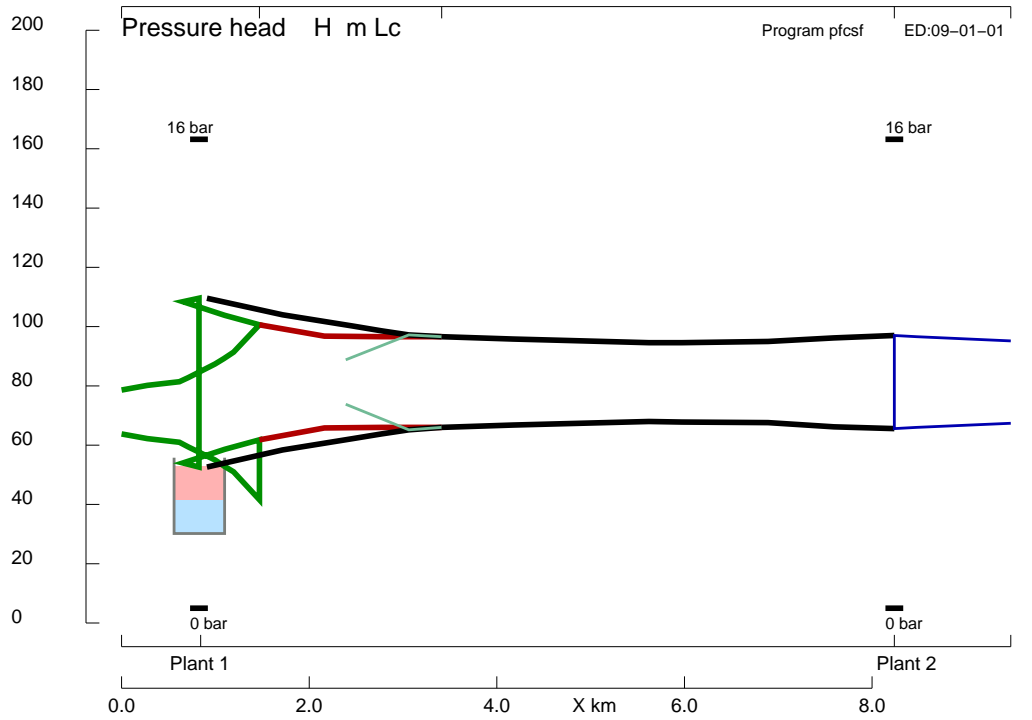



HYDRORAM AB

Simulation of a district cooling system

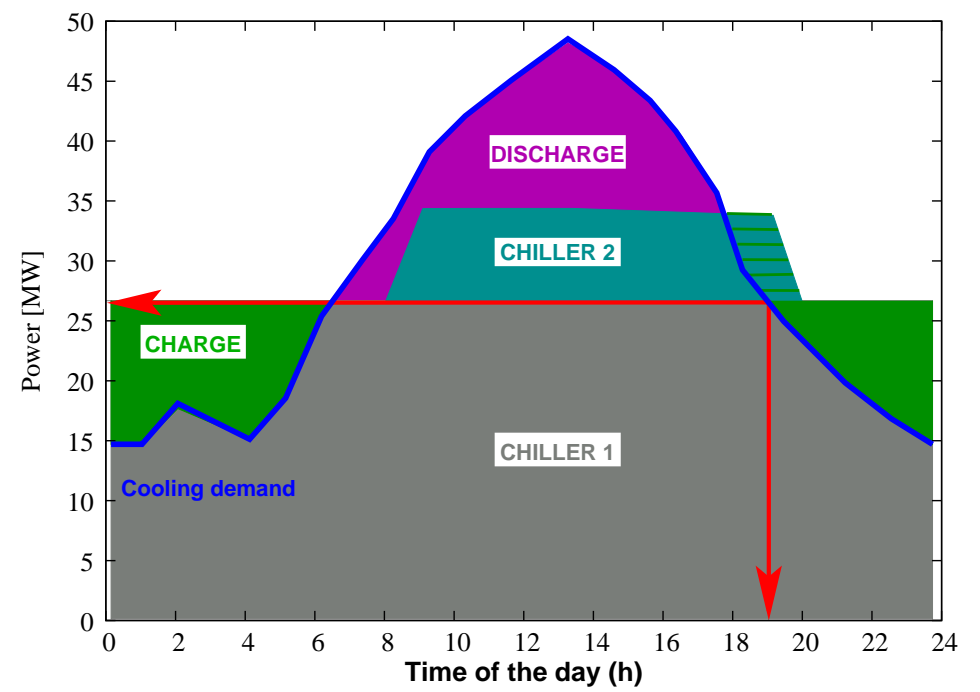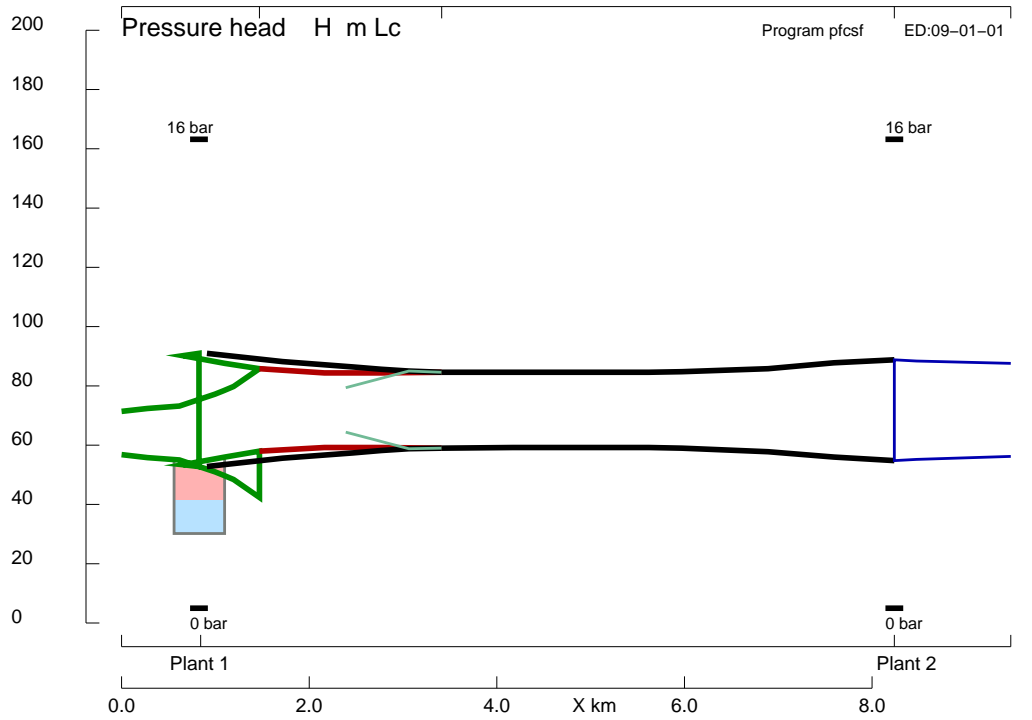



HYDRORAM AB

Simulation of a district cooling system

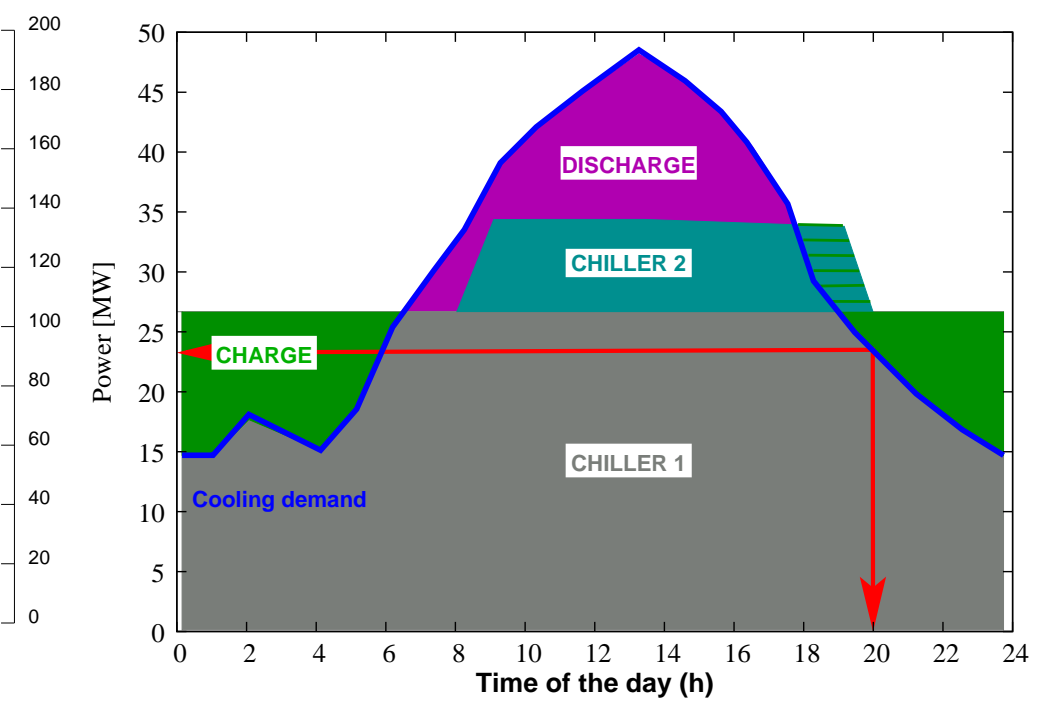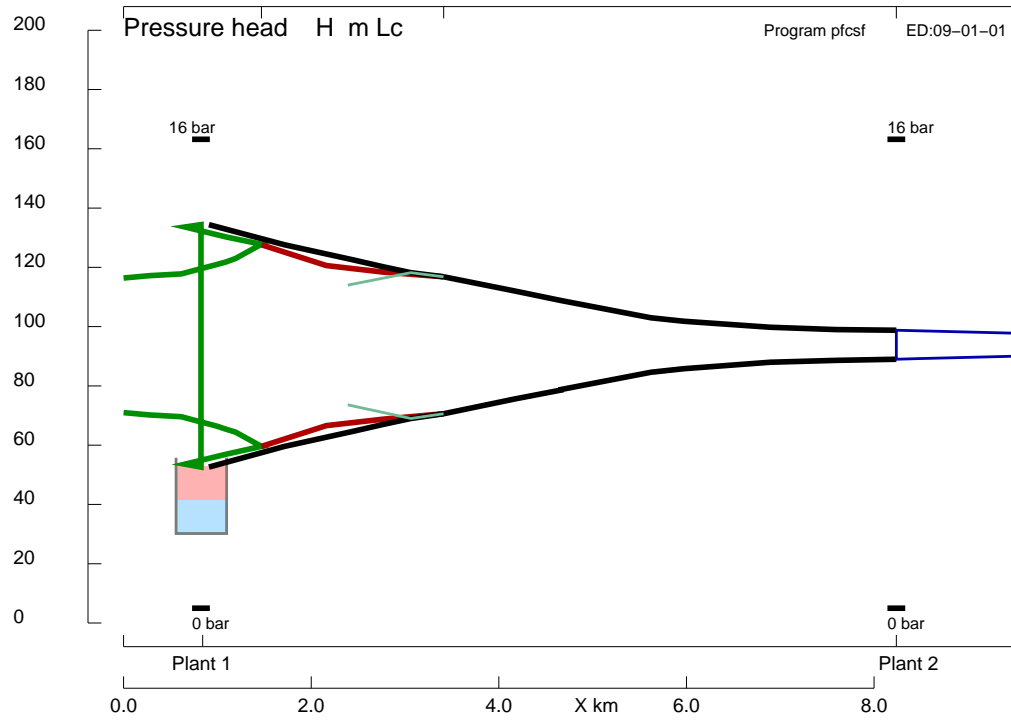



HYDRORAM AB

Simulation of a district cooling system

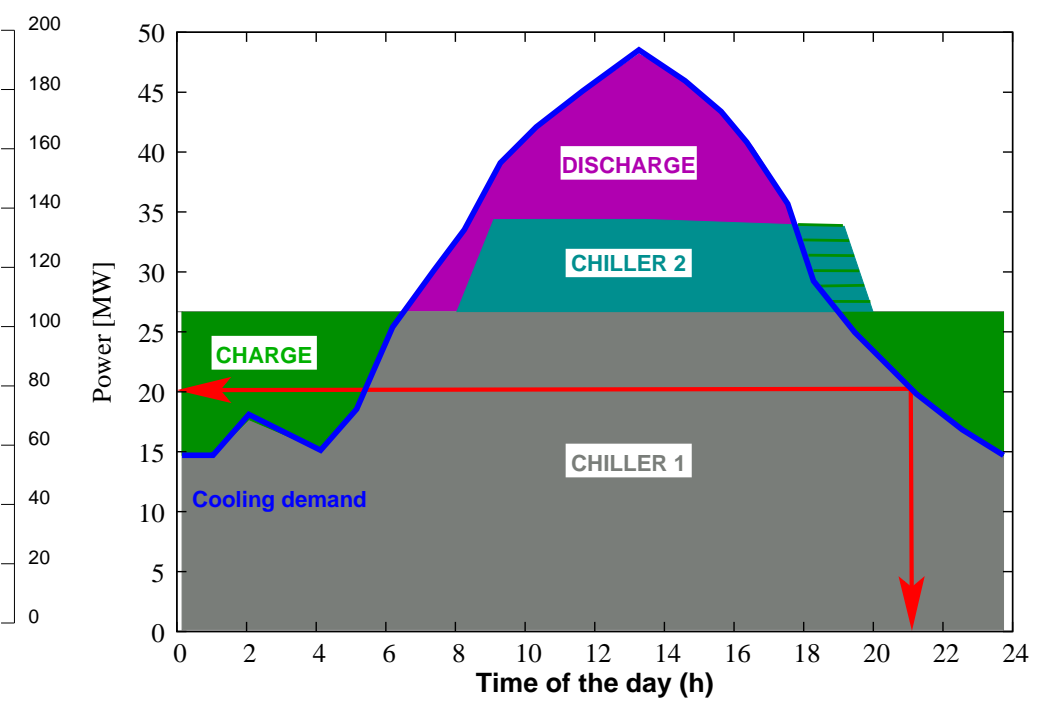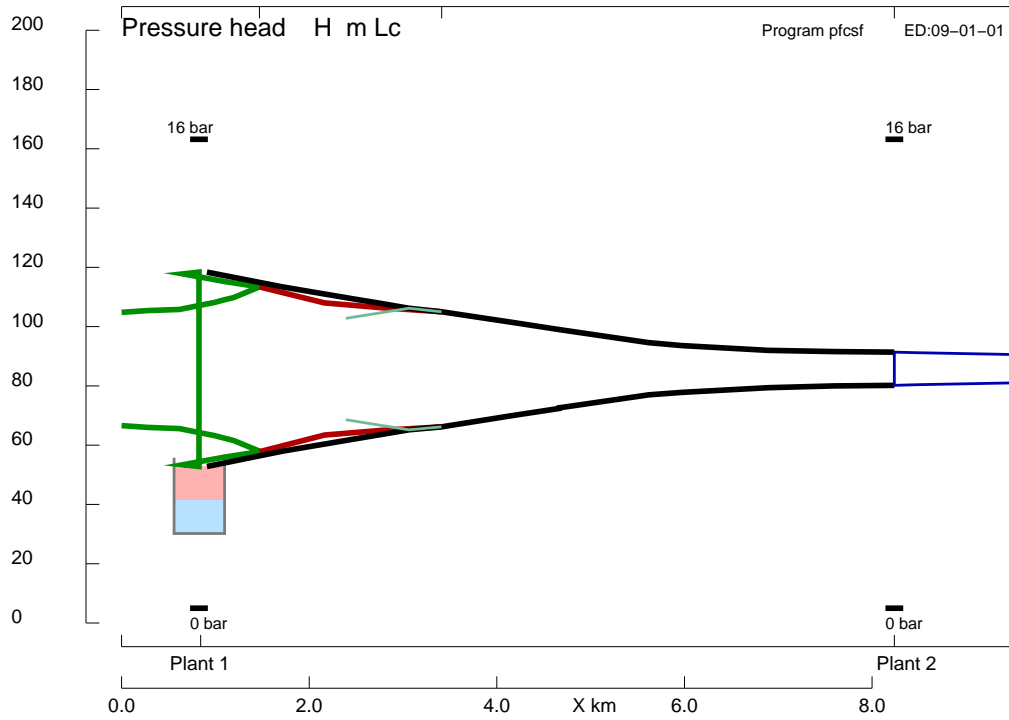



HYDRORAM AB

Simulation of a district cooling system

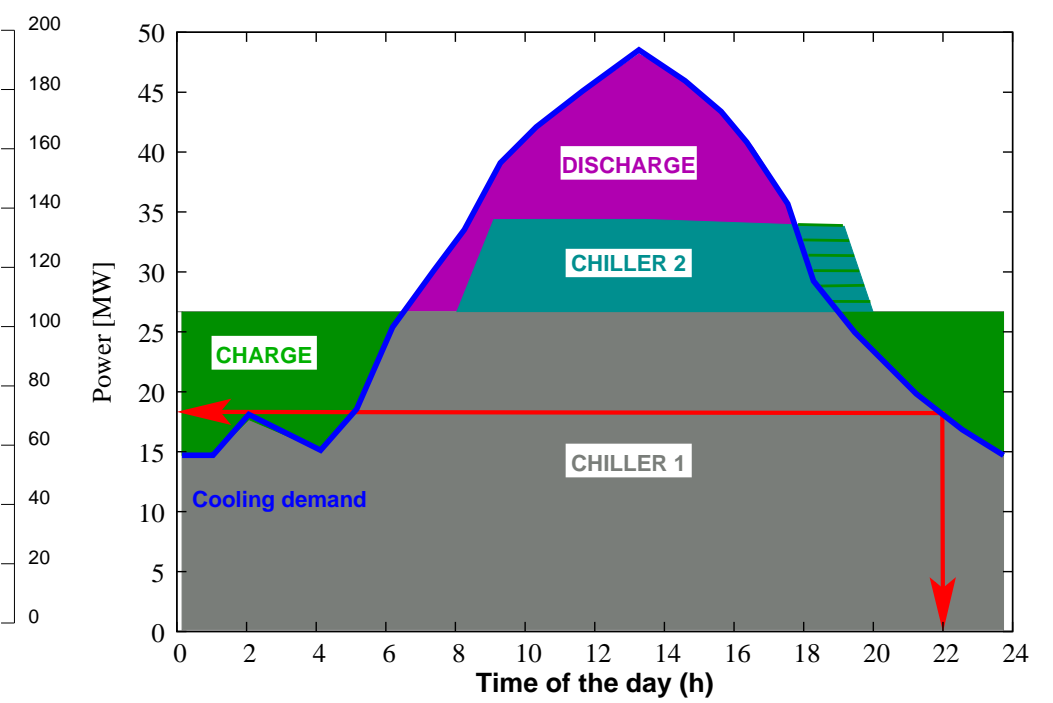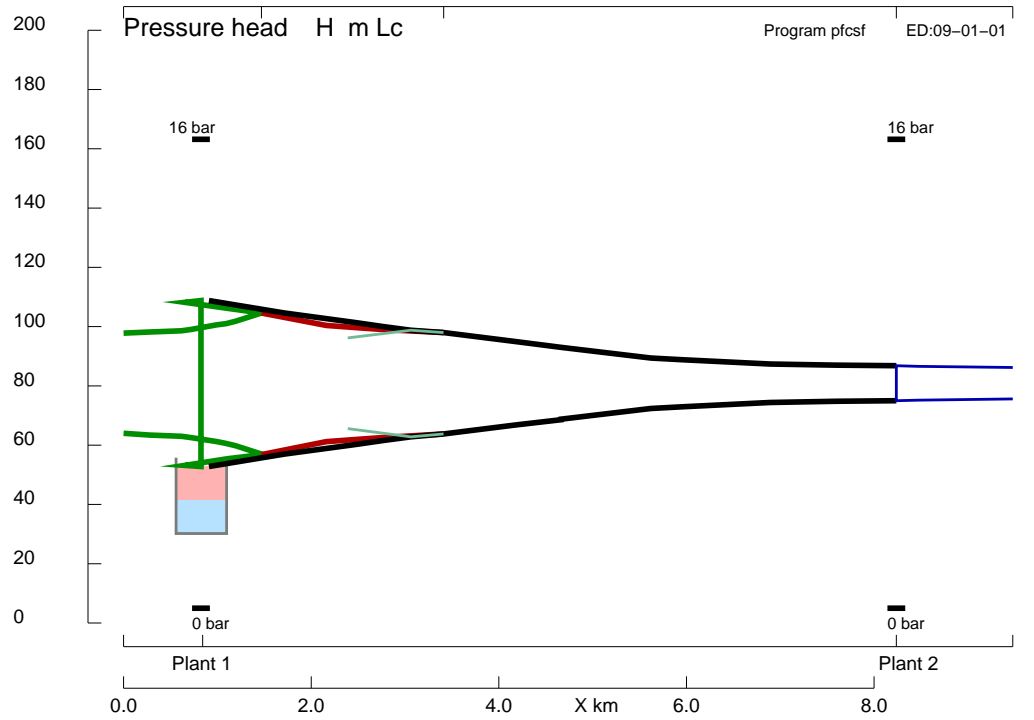

HYDRORAM AB

Simulation of a district cooling system

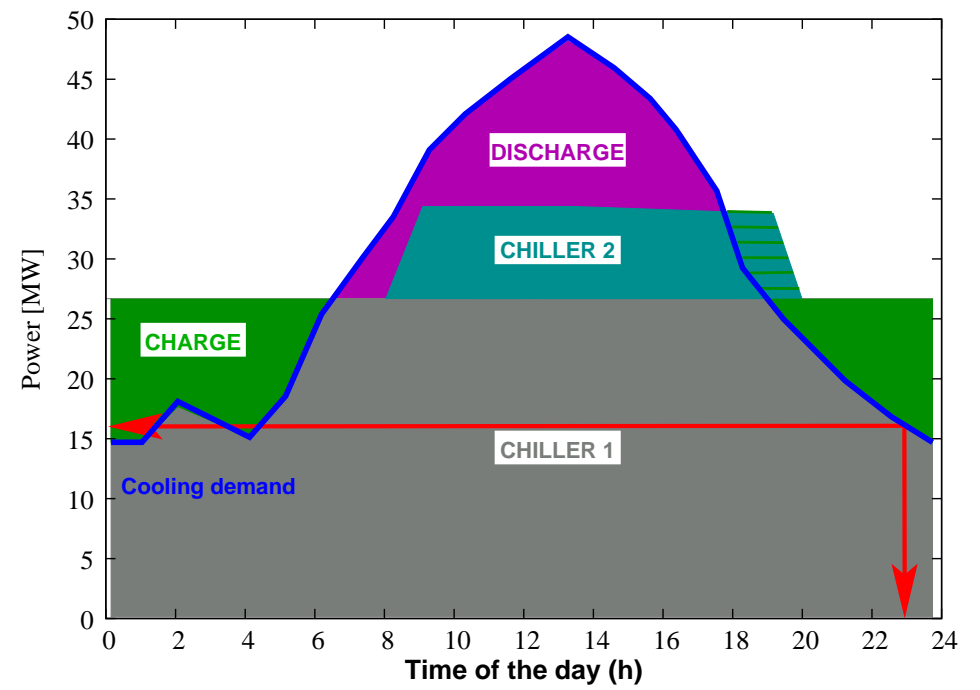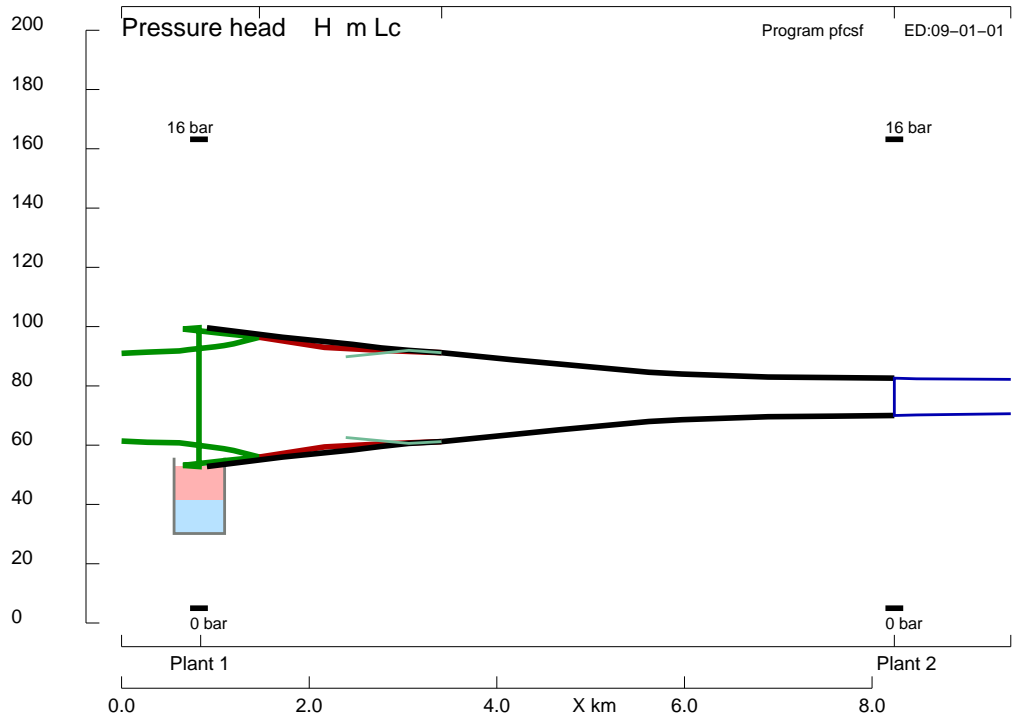

HYDRORAM AB

Simulation of a district cooling system

